

District Internal Water Quality Monitoring Laboratory Nizamabad at Z.P.Campus-503002

Report on Chemical Analysis of Drinking water.

Collection Date :- 05.09.2026 Received Date :- 05.09.2026

Village :- Nitawabad

Mandal :- Nitawabad Division :- Nitawabad

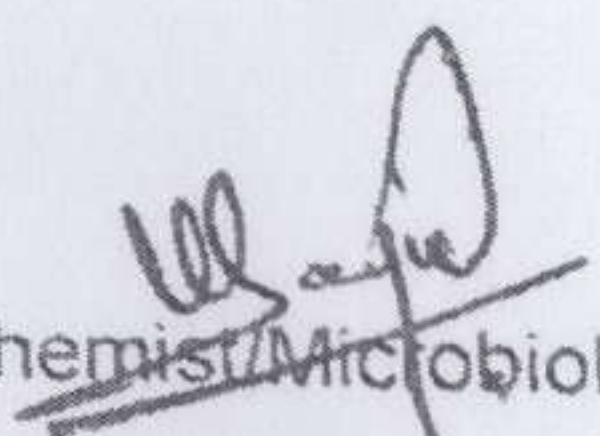
Dist :- Nitawabad Sample Collected By:-

Desirable Limit		6.5to8.5	1	1	500	200	300	75	250	1.0	45	0.30	30	150	
-----------------	--	----------	---	---	-----	-----	-----	----	-----	-----	----	------	----	-----	--

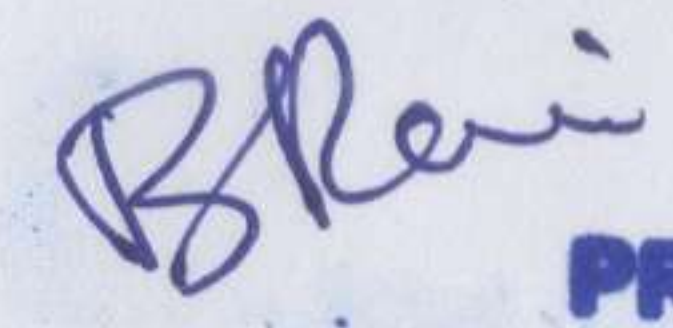
Maximum permissible limit in absence of alternative Source	No Relaxation	15	5	2000	600	600	200	1000	1.5	No Relaxation	1.00	100	400	
--	---------------	----	---	------	-----	-----	-----	------	-----	---------------	------	-----	-----	--

S No.	Source	Village & Location	pH	Colour	Turbidity (NTUS)	Total Dissolved Solids	Alkalinity (as CaCO_3)		Total Hardness (Caco3)	Calcium as (Caco3)	Chlorides as (Cl)	Fluoride as (F)	Nitrates as (No.3)	Iron as Fe	Meg-necium Mg.	Sulph-ates So_4	REMARKS
1	2	3	4	5	6	8	9	10	11	12	13	14	15	16	17	18	19
1	RO	Naraya Dharti Global School Nitawabad.	7.71	-	111	68	40		36	04	13	0.10	1.2	-	7	10	Zatli factory

Note : 1) All Standards are expressed in mg/litre except pH, Colour, EC and Turbidity.
2) Standards as per Bureau of Indian Standards I.S. 10500 : 2012


Chemist/Microbiologist

For SR AQUA SOLUTIONS


PROPRIETOR.